

TABLE 1--GENERAL SURVEY OF THE CONCRETE STRENGTH SERIES

Series	n (*)	Division in sub- series	Observation period (days)	Type of specimen	Mean daily sample rate
A	1786	A1...A9	1158	cubes (200 mm)	3.26
B	945	B1...B5	1044	cylinders	2.59
C	534	C1...C3	1233	"	2.32
D	1468	D1...D8	303 (D1...D4)	cubes (158 mm)	4
			422 (D5...D8)		4
E	1158	E1...E6	267 (E1...E3)	cubes (158 mm)	4
			526 (E4...E6)		2

(*) Total number of test results

TABLE 2--GENERAL CHARACTERISTICS OF THE CONCRETE STRENGTH SERIES

Series	n	$\bar{x}_n$ (MPa)	s_n (MPa)	δ (%)
A	1786	46.5	6.56	14.1
B	945	36.8	5.30	14.4
C	534	42.1	6.62	15.7
D	1468	59.9	3.68	6.1
E	1158	72.3	5.94	8.2

TABLE 3--GENERAL CHARACTERISTICS OF THE SUBSERIES

Sub-series	n	$\bar{x}_n$ (MPa)	s_n (MPa)	δ (%)	Sub-series	n	$\bar{x}_n$ (MPa)	s_n (MPa)	δ (%)
A1	200	45.8	5.47	11.9	D1	200	59.8	3.64	6.1
A2	199	48.8	6.35	13.0	D2	196	59.6	3.17	5.3
A3	200	50.2	6.78	13.5	D3	200	61.7	3.52	5.7
A4	200	48.3	5.73	11.9	D4	200	59.0	4.25	7.2
A5	200	44.5	5.74	12.9	D5	200	59.3	3.96	6.7
A6	200	44.8	5.89	13.1	D6	200	59.8	3.44	5.8
A7	200	46.3	6.33	13.7	D7	200	60.5	3.05	5.0
A8	200	43.2	6.08	14.1	D8	72	58.1	2.95	5.1
A9	187	46.8	7.13	15.2					
B1	200	39.0	5.40	13.9	E1	200	68.0	4.06	6.0
B2	200	34.9	4.83	13.8	E2	199	69.0	4.05	5.9
B3	200	36.5	5.33	14.6	E3	200	69.3	4.91	7.1
B4	200	37.0	4.69	12.7	E4	200	76.7	4.61	6.0
B5	145	36.4	5.52	15.2	E5	200	75.6	4.95	6.5
C1	200	46.1	6.67	14.5	E6	158	75.7	5.53	7.3
C2	200	40.9	5.17	13.6					
C3	134	37.9	5.01	13.2					

TABLE 4--SERIAL CORRELATIONS r_1 TO r_5 OF THE 31 SUBSERIES

Sub-series	r_1	r_2	r_3	r_4	r_5	Highest lag of significant r_k
A1	0.425	0.386	0.276	0.263	0.286	8
A2	0.258	0.128	0.113	-0.011	0.028	1
A3	0.226	0.084	0.091	0.072	0.083	1
A4	0.302	0.173	0.169	0.060	0.006	3
A5	0.196	0.115	0.044	0.011	0.096	1
A6	0.286	0.090	0.177	0.033	-0.023	3
A7	0.277	0.213	0.185	0.174	0.121	4
A8	0.227	0.089	0.145	0.143	0.120	7
A9	0.462	0.375	0.337	0.300	0.343	5
B1	0.323	0.287	0.077	0.149	0.076	2
B2	0.493	0.412	0.409	0.202	0.134	6
B3	0.536	0.535	0.449	0.393	0.358	12
B4	0.600	0.511	0.509	0.464	0.351	14
B5	0.199	0.145	-0.039	0.015	-0.097	1
C1	0.451	0.401	0.372	0.362	0.325	7
C2	0.437	0.319	0.300	0.328	0.244	6
C3	0.384	0.194	0.210	0.183	0.223	5
D1	0.432	0.326	0.306	0.237	0.080	4
D2	0.488	0.385	0.242	0.132	0.185	11
D3	0.461	0.412	0.246	0.269	0.217	5
D4	0.586	0.513	0.431	0.402	0.416	10
D5	0.561	0.341	0.272	0.198	0.103	3
D6	0.366	0.201	0.053	0.037	0.064	2
D7	0.389	0.211	0.180	0.221	0.241	5
D8	0.341	0.211	0.133	0.023	0.009	1
E1	0.369	0.144	0.227	0.146	0.116	3
E2	0.255	0.030	-0.018	0.107	0.104	1
E3	0.575	0.412	0.388	0.396	0.330	9
E4	0.358	0.278	0.263	0.179	0.104	6
E5	0.252	0.148	0.089	0.125	-0.037	1
E6	0.360	0.168	0.095	0.028	-0.010	1

TABLE 5--CALCULATED VALUES OF z_1 AND z_2 ACCORDING TO EQUATIONS (8) and (9)

Subseries	z_1		z_2	
	n = 5	n = 10	n = 5	n = 10
A1	0.704	0.662	0.799	0.801
A3	0.622	0.472	0.878	0.933
A4	0.628	0.532	0.874	0.898
A5	0.570	0.443	0.921	0.947
A6	0.572	0.509	0.918	0.911
A7	0.646	0.566	0.857	0.876
A8	0.551	0.508	0.934	0.912
Independent observations	$1/\sqrt{5}=0.447$	$1/\sqrt{10}=0.316$	1	1

TABLE 6--GENERAL CHARACTERISTICS OF THE CEMENT STRENGTH RECORDS

Subseries	n	$\bar{x}_n$ (MPa)	s_n (MPa)	δ (%)
F1	200	49.8	3.09	6.20
F2	200	50.8	2.92	5.75
G1	200	56.2	2.78	4.95
G2	200	57.4	3.14	5.47
H1	200	48.3	3.88	8.03
H2	200	46.6	2.92	6.27
I1	200	50.1	1.81	3.61
I2	200	52.4	2.21	4.22

TABLE 7--SERIAL CORRELATIONS OF THE CEMENT STRENGTH RECORDS

Sub-series	r_1	r_2	r_3	r_4	r_5	Highest lag of significant r_k
F1	0.595	0.508	0.435	0.365	0.294	12
F2	0.616	0.548	0.484	0.462	0.388	8
G1	0.207	0.157	0.014	0.107	0.118	2
G2	0.432	0.246	0.235	0.201	0.177	4
H1	0.481	0.454	0.403	0.328	0.166	4
H2	0.269	0.191	0.228	0.057	0.063	3
I1	0.330	0.349	0.402	0.287	0.274	6
I2	0.583	0.525	0.566	0.560	0.549	13

TABLE 8--PROPERTIES OF SAND DATA (378 OBSERVATIONS)

	Mean value	Standard deviation	Coefficient of variation
Fineness Modulus	2.991	0.154	5.1 %
Moisture content (%)	6.09	1.92	31.5 %

TABLE 9--SERIAL CORRELATIONS OF SAND DATA (378 OBSERVATIONS)

	r_1	r_2	r_3	r_4	r_5
Fineness Modulus	0.380	0.243	0.283	0.199	0.154
Moisture content (%)	-0.026	0.100	0.083	0.013	0.056

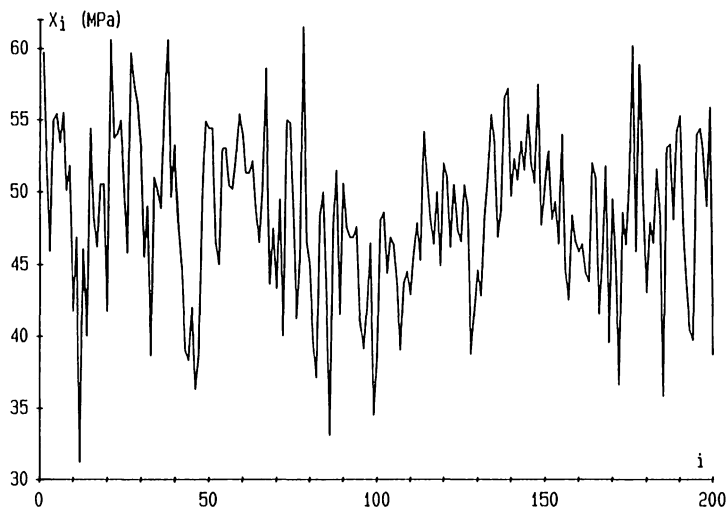


Fig. 1 -- Representation of Subseries A4

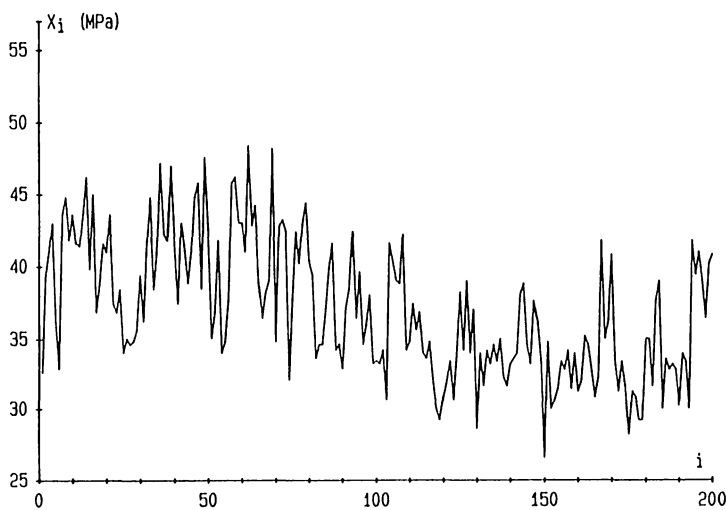


Fig. 2 -- Representation of Subseries B4

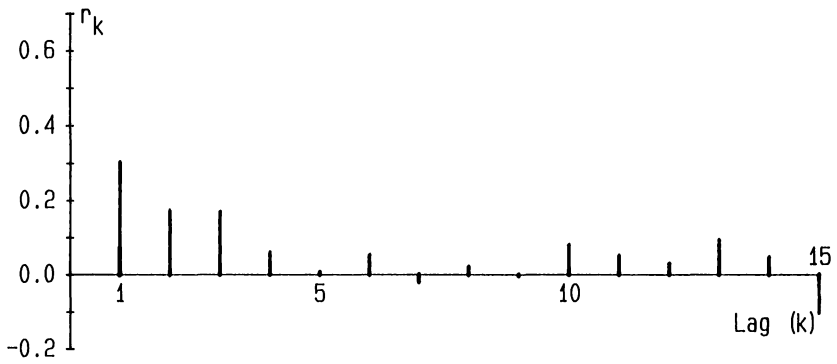


Fig. 3 -- Correlogram of Subseries A4

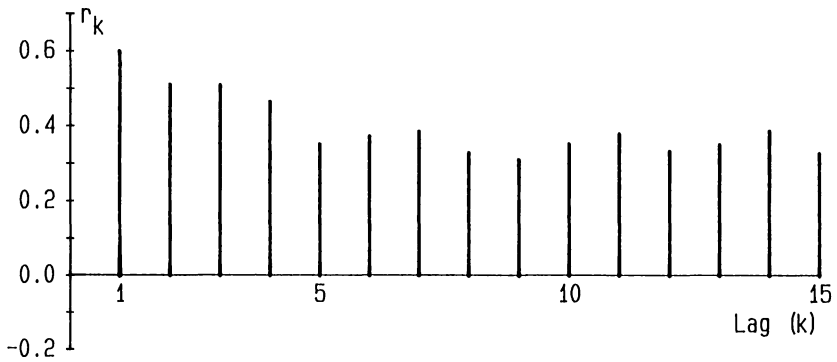


Fig. 4 -- Correlogram of Subseries B4

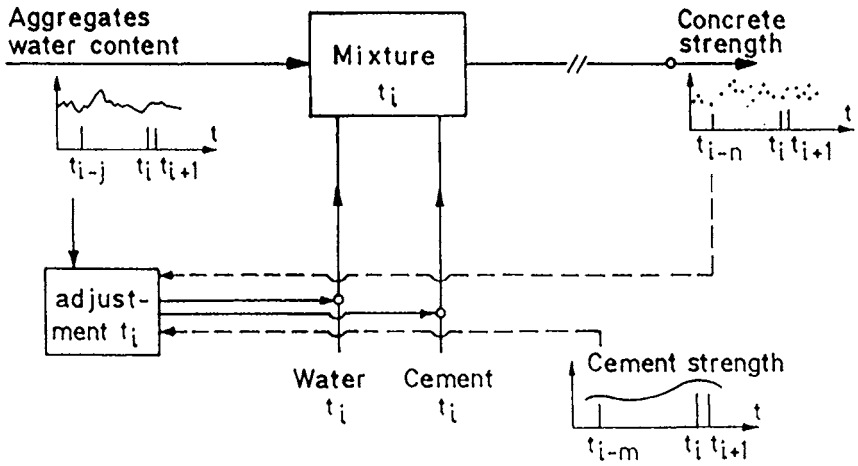


Fig. 5 -- Schematic representation of concrete production;
adapted from (2)

Quality Concrete Production for the California State Water Project

by J.H. Lawder and R.F. Adams

Synopsis -- The organization and procedures used in the quality production of about 8 million cubic yards of concrete of all kinds for the California Water Project are described. These included design aspects, specifications, the concrete laboratory and construction inspection forces, coordinated by a concrete engineer working full time as an internal consultant responsible for quality. Concrete strength requirements and the analysis of concrete strength results for acceptability of performance were based on concepts set forth in ACI Standard 214.

Keywords: compressive strength; concretes; inspection; quality assurance; quality control; statistical analysis; tests; water supply

ACI member John H. Lawder is Chief, Division of Design and Construction, California Department of Water Resources.

ACI member Robert F. Adams is a Consulting Engineer, Sacramento, California. He was formerly supervisor, Concrete and Soils Laboratory and Concrete Engineer, California, Department of Water Resources.

INTRODUCTION

The California State Water Project was built for the State of California by the Department of Water Resources to transport excess water from Northern California to supply the water deficiencies of the more arid southern areas where the majority of the population resides. The extent of the project is shown in Fig. 1.

The first phase of the project, which was completed in the 1970's, cost some 2-1/2 billion dollars and covered a length of several hundred miles, as shown in Fig. 1. This phase required about 8 million cu yd (6 Mm^3) of concrete in 22 dams and reservoirs, 6 power plants, 15 pumping stations, 540 miles (870 km) of aqueduct which includes 415 miles (670 km) of canal, 85 miles (135 km) of pipeline, 20 miles (32 km) of tunnel and 16 miles (26 km) of channel and reservoir, and miscellaneous related structures.

Following completion of the first phase, work on the project has continued, but at a slower pace, to build or complete facilities included in the project but deferred until the need developed. Already, the East Branch of the aqueduct is being enlarged by the addition of "sideboards" to increase the capacity and the enlargement of pumping plants and power plants and addition of siphon barrels and other necessary work.

Prior to the start of final design and construction, those responsible for building the project recognized the need for a coordinated program for control of quality concrete production, and of firm and attentive inspection of concrete construction for the project. This paper briefly describes the program.

The honoree of this Symposium, Lewis H. Tuthill, was hired by the Department in 1956 and served until 1969 when he retired. Mr. Tuthill was given the responsibility of starting the concrete construction program and setting the standards for it. He was fully supported by the Department management in carrying it out. The success of the program under Mr. Tuthill's direction is shown by the continuing excellent condition of the 8 million cubic yards (6 Mm^3) of concrete used in the structures and canal lining.